LEM

Current Transducers HAZ 4000..20000-SRU

For the electronic measurement of currents: DC, AC, pulsed, mixed, with a galvanic isolation between the primary circuit (high power) and the secondary circuit (electronic circuit).



Electrical data					
Primary nomina r.m.s. current I _{PN} (A)	l Primary current measuring range I _P (A)	Туре			
4000 6000 10000 12000 14000 20000	$\begin{array}{c} \pm \ 4000 \\ \pm \ 6000 \\ \pm \ 10000 \\ \pm \ 12000 \\ \pm \ 14000 \\ \pm \ 20000 \end{array}$	HAZ 4000-SRU HAZ 6000-SRU HAZ 10000-SRU HAZ 12000-SRU HAZ 14000-SRU HAZ 20000-SRU			
V _c I _c R _{IS} V _{out} R _{out} R _L	Supply voltage (± 5 %) Current consumption Overload capacity Isolation resistance @ 500 Output voltage @ $\pm I_{PN}$, R_{L} Output internal resistance Load resistance		± 15 ± 30 30,000 > 1000 0-10 100 > 10	ν mA ΜΩ V DC Ω kΩ	
Accura	acy - Dynamic perfo	rmance data			
X e _L V _{ое} V _{он} V _{от} TCe _G t, f	Accuracy (a) \mathbf{I}_{PN} , $\mathbf{T}_{A} = 25^{\circ}$ C Linearity error ¹⁾ (0 ± \mathbf{I}_{PN}) Electrical offset voltage, \mathbf{T}_{A} Hysteresis offset voltage (a) after an excursion of 1 x \mathbf{I}_{PP} Thermal drift of \mathbf{V}_{OE} Thermal drift of the gain (9) Response time (a) 90% of Frequency range, ±3 dB, s	_ = 25°C, @ I _P = 0 ⊉ I _P = 0; √ 6 of reading) I _{PN}	<pre>< ± 1 < ± 0.5 % < ± 100 < ± 12.5 < ± 1 < ± 0.05 < 400 DC and 15</pre>	m∖ mV/k %/k ms	
Genera	al data				
T _A T _S	Ambient operating temper Ambient storage temperat Housing PBT 30% glassf	ure	- 25 + 8 - 30 + 9		
	UL94 classification		V0		

V_{OUT} = 0-10 V (T-RMS DC)

I_{PN} = 4000..20000 A

Features

- Hall effect measuring principle
- Galvanic isolation between primary and secondary circuit
- True-rms, 0-10V DC voltage output
- Isolation voltage 12kV Rms/ 50 Hz / 1 min
- Low power consumption
- Package in PBT meeting UL 94-V0

Advantages

- Easy mounting
- Small size and space savings
- Only one design for wide current ratings range
- High immunity against external interference

Applications

- Battery supplied applications
- Uninterruptible Power Supplies (UPS)
- Power supplies for welding and telecom applications.

Application Domain

Industrial

kg

EN 50178:1997

Notes : 1) Linearity data exclude the electrical offset.

Mass

Standards 3)

- ²⁾ To avoid excessive core heating.
- ³⁾ Please consult characterisation report for more technical details and application advice.


approx. 6

m

Current Transducer HAZ 4000..20000-SRU

Isolation characteristics				
V _b	Nominal Voltage with IEC 61010-1 standard and following conditions - Single insulation - Over voltage category III - Pollution degree 2 - Heterogeneous field	2000	V r.m.s.	
V _b	Nominal Voltage with EN 50178 standard and following conditions - Reinforced insulation - Over voltage category III - Pollution degree 2 - Heterogeneous field	2000	V r.m.s.	
V _d	R.m.s. voltage for AC isolation test, 50/60 Hz, 1 mn	12	kV	
V	R.m.s. voltage for partial discharge extinction @ 10pC	>3	kV	
Ŷ Ŷ	Impulse withstand voltage 1.2/50µs	27	kV	
dĈp	Creepage distance	> 45	m m	
dCl	Clearance distance	> 45	mm	
СТІ	Comparative Tracking Index (Group IIIa)	220	V	



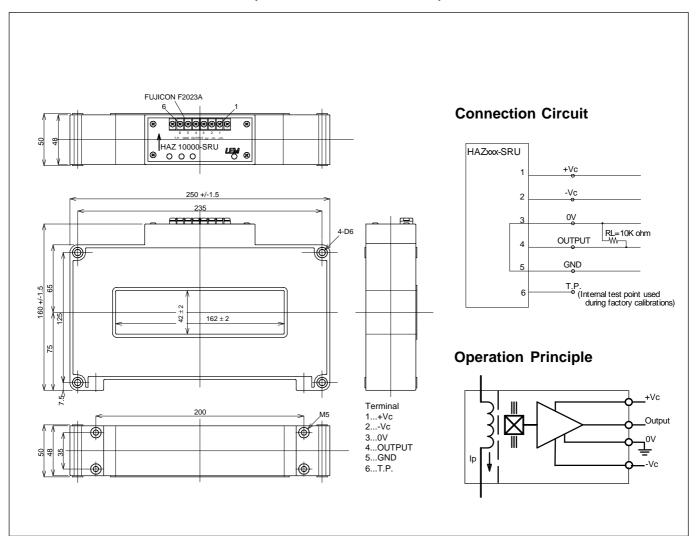

Dimensions HAZ 4000..20000-SRU (in mm. 1 mm = 0.0394 inch)

Mechanical characteristics

- General tolerance
- Aperture for primary conductor
- Transducer fastening
- Recommended fastening torque
- Connection of secondary

Remarks

• Temperature of the primary conductor should not exceed 120°C.

± 0.5 mm

 $(\pm 2 \text{ mm})$

(not supplied)

Fujicon F2023A (6 terminals)

4 x M5

< 5 Nm

162 mm x 42 mm

Safety



This transducer must be used in electric/electronic equipment with respect to applicable standards and safety requirements in accordance with the following manufacturer's operating instructions.



Caution, risk of electrical shock

When operating the transducer, certain parts of the module can carry hazardous voltage (eg. primary busbar, power supply). Ignoring this warning can lead to injury and/or cause serious damage.

This transducer is a built-in device, whose conducting parts must be inaccessible after installation.

A protective housing or additional shield could be used. Main supply must be able to be disconnected.